

ORDINANCE NO. 1 - 90

AN AMENDMENT TO KISKIMINETAS TOWNSHIP
ORDINANCE NO. 1-88 ENTITLED KISKIMINETAS
TOWNSHIP SEWER SYSTEM RULES AND REGULATIONS.

WHEREAS, the Board of Supervisors enacted an Ordinance entitled Kiskiminetas Township Sewer System Rules and Regulations also known a Kiskiminetas Township Ordinance No. 1-88; and,

WHEREAS, the Township's consulting engineer has recommended that certain changes be made to the Ordinance aforesaid to conform to standards required by the Pennsylvania Department of Environmental Resources; and,

WHEREAS, the Board of Supervisors wish to comply with the new regulations promulgated by the State Agency aforesaid;

WHEREAS, the Board of Supervisors desires to require an inspection fee for all lateral connections;

NOW THEREFORE, the Board of Supervisors of Kiskiminetas Township, Armstrong County, Pennsylvania, hereby amend Ordinance No. 1-88 as follows:

I: Sections 911 through Sections 916 inclusive as contained on pages 18 and 19 of the Ordinance No. 1-88 are amended and the new pages 18 and 19 which are attached hereto shall be substituted

in their place.






II. Page 19a which is attached hereto and identified as Kiskiminetas Township - Typical Lateral Connection Detail is the sketch referred to in new section 911 and shall be also be included as part of Ordinance 1-88.

III. The Board of Supervisors hereby enacts a sewage inspection fee of \$10.00 per visit with a maximum charge of \$35.00 payable to Kiskiminetas Township for inspections performed by the authorized representative of Kiskiminetas Township prior to the time lateral sewers may be connected to the main sewer lines owned by the Township.

IV. This ordinance is to become effective on April 1, 1990.

IN WITNESS WHEREOF, the parties hereto, intending to be legally bound, have hereunto set their hands and seals at the regular meeting of the Kiskiminetas Township Board of Supervisors held on Wednesday, March 14, 1990.


Township Seal

Section 906. Connections to sanitary and combined sewers shall be completed within sixty (60) calendar days after receipt of proper notice.

Section 907. All connections to the sanitary or combined sewers shall be subject to certain restrictions as to unacceptable sanitary sewage which are set forth herein and in the Authority's Rules and Regulations.

Section 908. The designated Inspector of the Township shall be given at least twenty-four (24) hours notice before any connection is made to the system so that said Inspector can be present to inspect and approve the work of building the sewer and connection. The Inspector shall signify his approval to the connection by endorsing his name and the date of approval on the aforementioned connection permit in the possession of the permittee. The Inspector shall be permitted to enter upon all properties receiving sewer service for the purpose of inspection, observation, measurement, sampling and testing; such entries to be made only during reasonable daylight hours with prior notification to the customer.

Section 909. At the time of inspection of the connection, the owner or owners of properties shall permit the Inspector full and complete access to all sanitary and drainage arrangements and facilities in each building and in and about all parts of the property. No building sewer line shall be covered over, or in any manner concealed, until after it is inspected and approved by said Inspector.

Section 910. It is the intention of these Rules and Regulations that the entire connection be inspected at one time; however, if the property owner feels that special conditions warrant more than one inspection, he may request the same, subject to such additional inspection fees as the Township shall determine.

Section 911. All pipe installed shall be

1. PVC polyvinyl chloride plastic sewer pipe SDR 35, having either a rubber ring or Scheduled 40 having a solvent cemented joint (ASTM D-3033 or 3034).

REFER TO THE SKETCH OF A TYPICAL LATERAL CONNECTION

All pipe installed shall be at least 4 inches in diameter. Each section of pipe shall be stamped with the manufacturer's certification.

Section 912. All sewer pipe shall be installed in strict accord with the manufacturer's recommendations. Where rock trench foundation exists, a 4" gravel cradle shall be provided under the pipe.


Section 913. All pipe shall be installed with a minimum slope of 1/8" per foot and a minimum cover of three and one-half (3.5') feet unless otherwise approved. All pipe shall be laid to an even grade and straight alignment to the public sanitary sewer. All pipe shall be laid with full and even bearing and no block supports will be allowed. Bell holes shall be dug to allow sufficient space to properly make each joint. Backfill shall be tamped uniformly around the pipe. All work shall be done in a work manlike manner and shall provide a durable installation.

Section 914. A 4-inch trap with a 4-inch vent shall be installed a maximum of five feet from the building. The vent shall be so situated as not to allow the discharge of any surface water to the sanitary sewer. A 4 inch inspection port shall be installed at the property line.

Section 915. Commercial installations must also comply with all local construction regulations.

Section 916. Maintenance and repair of all building sewers shall be the responsibility of the property owner.

KISKIMINNETAS TOWNSHIP
 TYPICAL LATERAL CONNECTION DETAIL
 DEC 1989

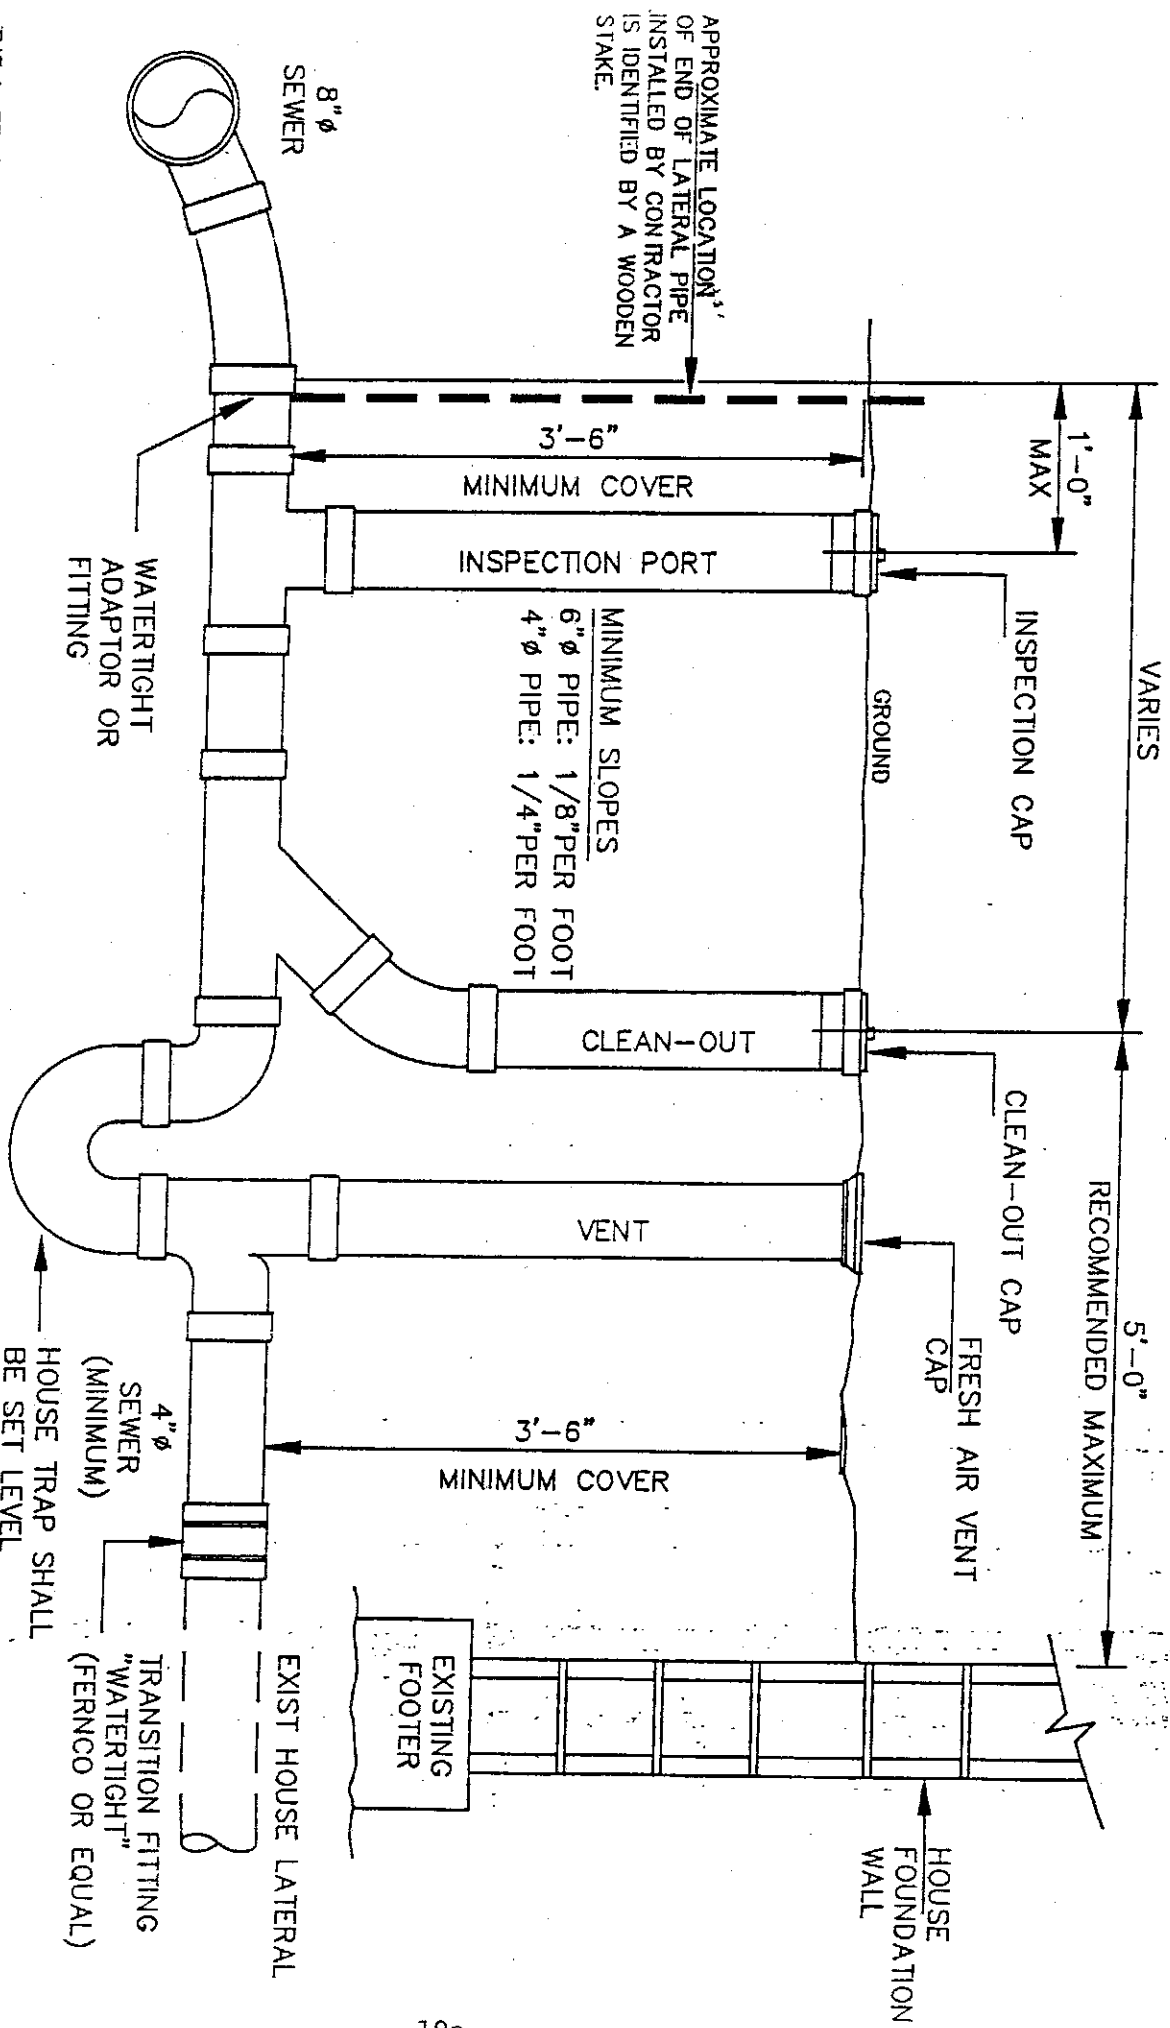

APPROXIMATE LOCATION OF END OF LATERAL PIPE INSTALLED BY CONTRACTOR IS IDENTIFIED BY A WOODEN STAKE.

1'-0" MAX

3'-6" MINIMUM COVER

INSPECTION PORT

INSPECTION CAP

GROUND

MINIMUM SLOPES
 6" ϕ PIPE: 1/8" PER FOOT
 4" ϕ PIPE: 1/4" PER FOOT

CLEAN-OUT

CLEAN-OUT CAP

5'-0" RECOMMENDED MAXIMUM

FRESH AIR VENT CAP

3'-6" MINIMUM COVER

EXIST HOUSE LATERAL

EXISTING FOOTER

HOUSE FOUNDATION WALL

8" ϕ SEWER

WATERTIGHT ADAPTOR OR FITTING

HOUSE TRAP SHALL BE SET LEVEL

4" ϕ SEWER (MINIMUM)

TRANSITION FITTING "WATERTIGHT" (FERNCO OR EQUAL)

THE LATERAL PIPE SHALL BE EITHER 4" OR 6" DIAMETER PIPE. THE PIPE SHALL BE POLYVINYL CHLORIDE SEWER PIPE SDR 35 WITH A RUBBER RING AT EACH JOINT OR SCHEDULE 40 WITH SOLVENT CEMENTED JOINTS. (ASTM D-3033 OR 3034).

IN ALL CASES THE SEPTIC TANK MUST BE BY-PASSED. THE CLEAN-OUT SHOULD BE BROUGHT TO GROUND LEVEL. THE FRESH AIR VENT SHALL BE ABOVE GROUND LEVEL TO PREVENT STORM WATER ENTERING SANITARY SEWER.

A CLEAN-OUT SHALL BE INSTALLED EVERY 50 FEET, AND AT MAJOR CHANGES IN DIRECTION.

6. INSTALL 2B STONE 4 INCHES BELOW PIPE FOR BEDDING AND ONE FOOT OVER TOP OF PIPE FOR SUPPORT AND PROTECTION.
7. THE LOCATION OF THE INSPECTION PORT SHALL BE REFERENCED TO TWO EXISTING PERMANENT FEATURES AND RECORDED WITH THE TOWNSHIP FOR FUTURE USE.
8. ALL YARD DRAINS, DRIVEWAY DRAINS, FRENCH DRAINS, DOWNSPOUTS AND ALL OTHER STORM WATER AND GROUND WATER CONVEYANCE AND COLLECTION DEVICES SHALL NOT BE CONNECTED INTO THE SANITARY SEWER.